


Adjustments

- ZXME/ZXDE:

- For R134a standard MT operation it is recommended to adjust PS1 to 0,5 bar

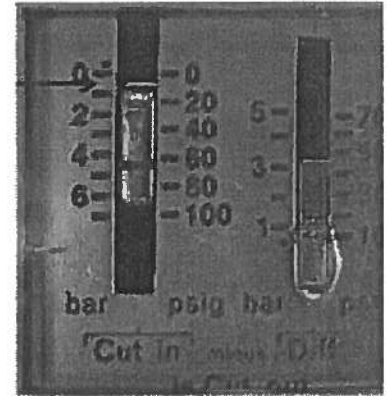

- ZXDE only:

- It is recommended to change the parameters of XC645 controller to the values shown in the table

Name	Value	Program level	Function
SEtc	1.0	Pr1	Setpoint compressor (bar)
SEtF	8	Pr1	Setpoint fan (bar)
LAL	-0.2	Pr2	Pressure alarm suction low (bar)
HAL	3.0	Pr2	Pressure alarm suction high (bar)
LAF	3.0	Pr2	Pressure alarm condensing low (bar)
HAF	20.0	Pr2	Pressure alarm condensing high (bar)
FtyP	134	Pr2	Refrigerant type

Emerson Climate Technologies, ZX, Page 5


EMERSON.
 Climate Technologies